



Executive Engineer, W/S & Sanitation Division, Shaheed Bhagat Singh Nagar

01823-221184

e-mail:eedwss.sbsnagar@punjab.gov.in

Annexure C

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No. 7525

Date: 29-05-2026

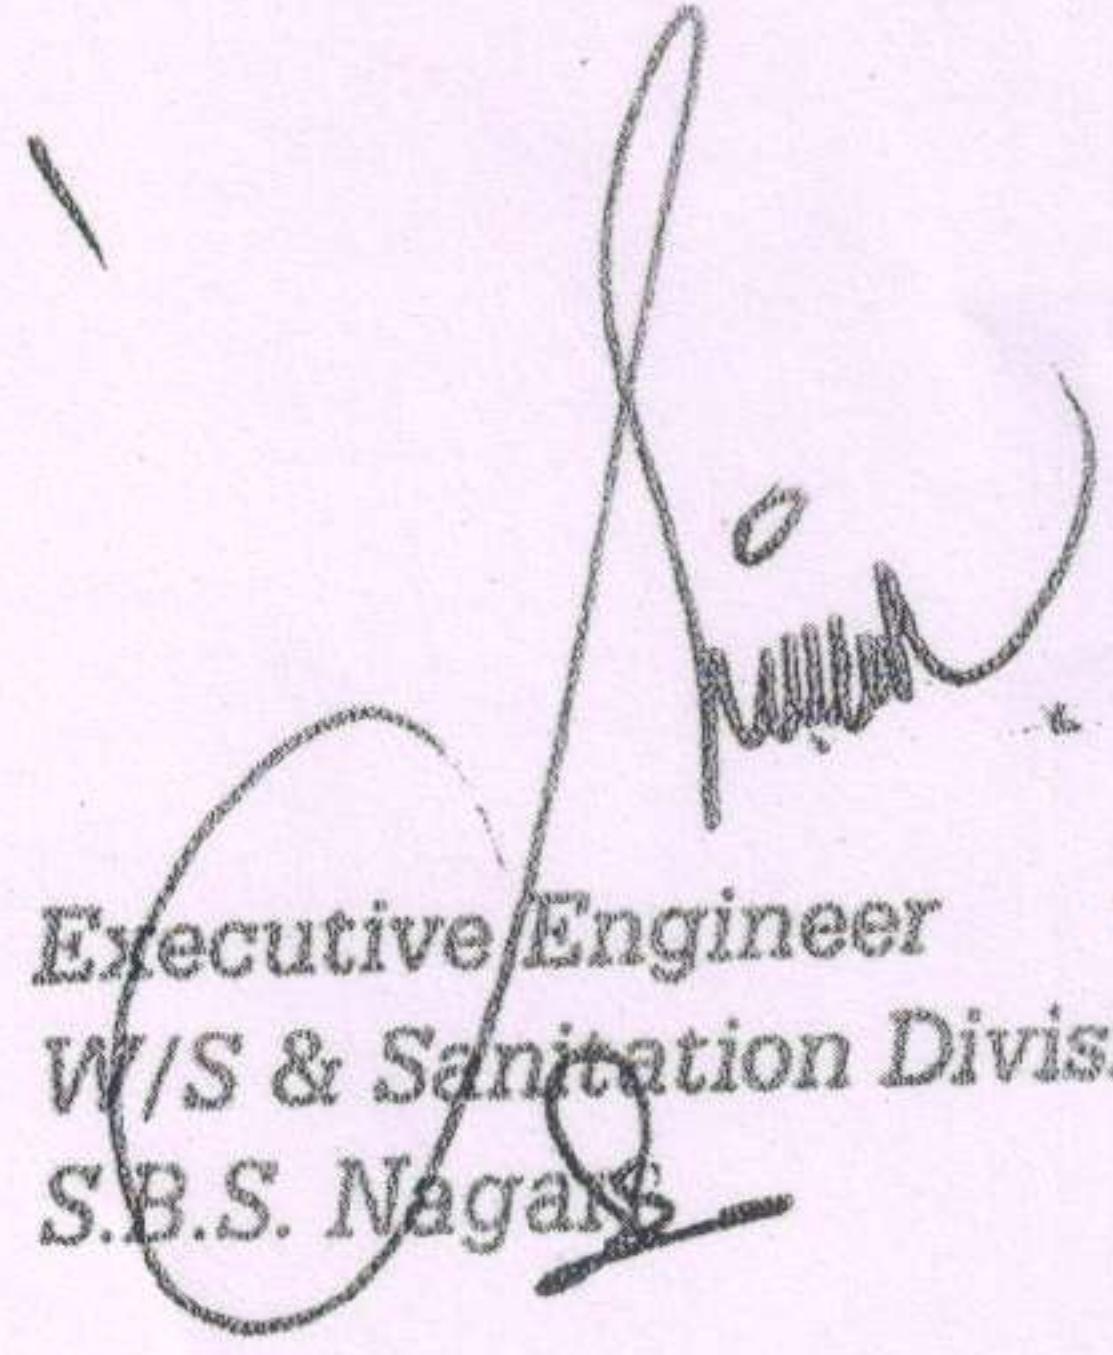
It is certified that an inspection team headed by ER PARSUNDEEP SINGH SDE AND ER GURPREET SINGH JE DWSS SUB DIV NO. 1 NAWANSHAHR office of EXECUTIVE ENGINEER W/S & SANITATION DIVISION, SHAHEED BHAGAT SINGH NAGAR PUNJAB. from inspected the SHIV CHAND PUBLIC HIGH SCHOOL SAKOHPUR, SBS NAGAR, PUNJAB on 25.05.2026 and on the basis of Water Test Report (Attached) bearing No DWTLSBS/2627/00012 DATED 17.04.2026 of DISTRICT WATER TESTING LAB, SBS NAGAR, PUNJAB (PHED Lab) certified that the SHIV CHAND PUBLIC HIGH SCHOOL has safe drinking water facilities for the students and members of staff of the institution. School also maintains the hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/State/U.T. Govt

This certificate is valid for period of one year till 28.05.2027


Principal
Shiv Chand Public High School
Sakoh Pur, P.O. Shahlon (Nawanshahr)
S.B.S. Nagar (Punjab) - 144514

To

Shiv Chand Public High School
Sakohpur, Distt. SBS Nagar, Punjab


Executive Engineer
W/S & Sanitation Division
S.B.S. Nagar



TC-14062

TEST REPORT						
Name & Address of Customer : Shiv Chand Public High School Sakohpur Shiv Chand Public High School Sakohpur, SBS Nagar			Customer Reference No.		No : Ref No. SCPHS/0426/52 Dated : 13/04/2026	
			Sample Submitted by		Mr. Sunil Kumar	
			Date of Sample Receipt		15/04/2026	
			Analysis Starting Date		15/04/2026	
			Analysis completion Date		17/04/2026	
Discipline : Chemical Testing			Group: Water			
ULR No.:	TC988126000000078F		Sample Type :		Water	
Test Report No.:	DWTLBS/2627/00012		Date of Issue :		17/04/2026	
Registration no.:	DWTLBS/REG2627/00035		Condition of Sample :		Unsealed	
Collection Point:	Treatment Plant (RO/CWPP/ARP/HH Purifier)		Quantity/Type of Bottle:		1000 ml / Plastic Bottles	
Scheme/Source:	Not Mentioned(Not Mentioned)		Location/Depth :		Shiv Chand Public High School (R.O. system) / NA	
Village :	Sakohpur		Habitation :		Sakohpur	
Block:	Aur		District :		SBS Nagar	
Latitude :	Not Mentioned		Longitude:		Not Mentioned	
Sr. No	Parameter	Result	As per IS-10500:2012 (2nd Rev.)		Unit	Reference Method :
			Acceptable Limit	Permissible Limit		
1	pH	7.11@25°C	6.5-8.5	No Relaxation	--	IS 3025 (Part 11-2022) Electrometric Method
2	Colour	<5	5	15	CU	IS 3025(Part 4-2021) Visual Comparison Method
3	Odour	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 5 – 2018) (Second Revision)
4	Taste	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 8 – 2023)
5	TDS	68	500	2000	mg/l	IS 3025 (Part 16-2023) Gravimetric Method
6	Turbidity	0.6	1	5	NTU	IS 3025 (Part 10-2023) Nephelometric Method
7	T. Alkalinity(CaCO ₃)	38	200	600	mg/l	IS 3025 (Part 23-2023) Indicator Method
8	T. Hardness(CaCO ₃)	44	200	600	mg/l	IS 3025 (Part 21- 2009)(RA 2023) EDTA Method
9	Calcium(Ca)	8.81	75	200	mg/l	IS 3025 (Part 40-2024) EDTA Titrimetric Method
10	Magnesium(Mg)	5.34	30	100	mg/l	APHA (24th Ed.2023) Method: 3500-Mg+2 B By Calculation Method
11	Chloride(Cl)	5	250	1000	mg/l.	IS 3025 (Part 32-2025) Argentometric Method

This Report is issued under the following terms & Condition :

1. The results apply to the sample as received only.
2. The sample will be destroyed after retention time unless otherwise specified specially.
3. This report is not to be reproduce wholly or in part and can't be used as evidence in court of law.
4. Abbreviation used (TDS = Total Dissolved Solids, mg/l = milligram per liter, BDL = Below detection limit, APHA = American Public Health Association, IS = Indian Standard, NT = Not Tested, NA = Not Applicable NTU = Nephelometric Turbidity Unit, RA = Reaffirmed, ND=Not Detected, T=Total)
5. * Value not available or test not performed for this parameter.
6. Temperature condition limit: 25±5°C and Humidity condition limit:50 ±20%

Principal
Shiv Chand Public High School
Sakoh Pur, P.O. Shahlon (Nawanshahr)
S.B.S. Nagar (Punjab) - 144514

Reviewed and Approved By

Mr. Davinder Singh
Chemist/Analyst
Authorized Signatory
For, District Water Testing Laboratory
SBS Nagar

----- End of the Test Report -----